Series 990/990RPDA

Reduced Pressure Zone Backflow Preventer

Sizes: 4", 6", 8" (100mm, 150mm, 200mm)

- BACKFLOW PREVENTION
- CONTAINMENT
- CROSS CONNECTION CONTROL





1-800-336-6530



A reduced pressure zone backflow prevention assembly shall be installed at each cross connection to prevent backsiphonage and backpressure backflow of hazardous materials into the potable water supply. The assembly shall consist of a pressure differential relief valve, accessible from either side of the assembly, located in a zone between two positive seating bronze sealed stainless steel check valves. The assembly shall feature captured springs, replaceable seats and seat discs in a modular unit. Springs shall be center stem guided. Access to each check module shall be through a top access bolted cover. The relief valve shall be compact bottom mounted with a single discharge port. The assembly shall include two shutoff valves before and after the device and four test cocks. The assembly shall be a Watts Regulator Company Series 990.

IMPORTANT: Inquire with governing authorities for local installation requirements.

ATTN. INSTALLER: After installation, please leave this Instruction Sheet for occupant's information.

Installation, Service, Replacement Parts and Maintenance

For field-testing procedure, send for IS-TK-DL. For technical assistance, see back page.

Annual inspection of all water system safety and control valves is required and necessary. Regular inspection, testing and cleaning assures maximum life and proper product function.




Troubleshooting Guide

Backflow Preventers

DDOD! 514	Backflow Fleventer.com	Should valve	SOLUTION WO
PROBLEM	CAUSE	be replaced?	SOLUTION
A. Valve spits periodi			ompany
	A.1 Fluctuating supply pressure.	No Leventes com	A.1 Install a spring-loaded, soft seated check valve immediately upstream of the device.
	A.2 Fluctuating downstream pressure.	No	A.2 Install a spring-loaded, soft seated check valve downstream of the device as close as possible to the shutoff valve.
B. Valve drips contin	ually from the vent.		Oli Della Jigan
Badiflow	B.1 Fouled first check.	No //ww/	B.1 Flush valve. If flushing does not resolve problem, disassemble valve and clean or replace the first check.
	B.2 Damaged or fouled relief valve seat.	No	B.2 Clean or replace the relief valve seat.
	B.3 Relief valve piston "0" ring not free to move due to pipe scale, dirt or build-up of mineral deposits.	No	B.3 Clean, grease or replace the piston "O" ring.
	B.4 Excessive backpressure, freezing, or water hammer has distorted the second check.	No GIEP Penter.com	B.4 Eliminate source of excessive backpressure or water hammer in the system downstream of the device. Use Watts No. 601 to dampen out backpressure and No. 15 to eliminate water hammer. Replace defective second check assembly. In case of freezing; thaw, disassemble, and inspect internal components. Replace as necessary.
	B.5 Electrolysis of relief valve seat or first check seats.	No No	B.5 Replace relief valve seat or inlet cover. Install dielectric unions (Watts Series 3001 through 3006). Electrically ground the piping system and/or electrically isolate the device with plastic pipe immediately upstream and downstream of the device.
	B.6 Valve improperly reassembled.	Dec ^{No}	 B.6 If valve is diassembled during installation, caution must be exercised to install check springs in their proper location.
C. Valve exhibits high	n pressure drop.		Backflow Hewester com - 1
	C.1 Fouled strainer.	No	C.1 Clean strainer element or replace.
	C.2 Valve too small for flows encountered.	Yes	C.2 Install proper size device based upon flow requirements.
D. No water flows do	ownstream of valve.		OMDONA
	D. Valve installed backwards.	No	D. Install valve in accordance with flow direction arrow.
E. Valve does not tes	t properly.	muca com	
THE THE STATE OF T	E.1 Follow manufacturer's test procedure.E.2 Leaky downstream gate valve.	No No	E.1, E.2 Clean or replace gate valve with full port ball valves or resilient wedge shutoff valves.
F. Valve quickly and	repeatedly fouls following servicing.		Bask
	F. Debris in pipe line is too fine to be trapped by strainer.	No	F. Install finer mesh strainer element in the strainer.
G. Winterization of b	ackflow preventers.	ompa	G. Prevent freeze damage by enclosing a WATTSBOX heated enclosure. For additional information, send for ES-WB or ES-WB-T.
	Badiflow Preventer com Special lies	Water	ES-WB or ES-WB-T.

Check Valves 4", 6" and 8" (100mm, 150mm, 200mm)

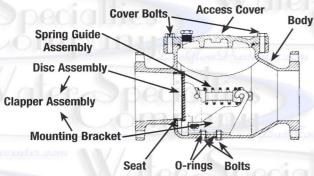

Spring Guide Assembly Removal Instructions

- 1. Remove the access cover.
- 2. The 990 features a captured spring in a center stem guided assembly. The spring guide assembly must be removed to clean the seat disc. To remove the spring assembly from the mounting bracket, remove the two bolts on the bottom of the body opposite the access cover. This will allow the spring module to be removed from the notches on the mounting bracket. (Fig.1) As with any spring loaded mechanism, keep fingers away from pinch points. The spring guide assembly has a heavy spring pre-load and could cause injury. It is not necessary to disassemble the spring guide assembly.

To Replace

- 1. Bolt the mounting bracket back in place after lubricating the bolt O-rings.
- 2. Position the back of the spring guide into the rear hook of the mounting bracket.
- 3. Apply leverage between the spring guide assembly and the disc assembly as shown in Fig.2. Compress spring assembly slightly and push down to position the spring assembly in the front notches.

Complete Repair Kits

0887336

0887337

0887338

Ordering Cod		Si	
1st Check Rep	air Kits	in.	mm
0887315	RK 990 CK1	4	100
0887316	RK 990 CK1	6	150
0887317	RK 990 CK1	8	200
2nd Check Rep	pair Kits	allel,	
0887318	RK 990 CK2	4	100
0887319	RK 990 CK2	6	150
0887320	RK 990 CK2	8	200
Kits consist of: Spring as:	sembly & Cover O-ring		
Check Rubber	Parts		
0887321	RK 990 RC4	4	100
0887322	RK 990 RC4	6	150
0887323	RK 990 RC4	8	200
Kits consist of: Cover 0-r	ing, 2 Bolt O-rings & Disc for	one check	
Seat Kits	1		
0887330	RK 990 S	4	100
0887331	RK 990 S	6	150
0887332	RK 990 S	8	200
Kits consist of: Seat & Se	eat O-ring for one check		
Complete Rub	ber Parts		
0887333	RK 990 RT	4	100
0887334	RK 990 RT	6 8	150
0887335	RK 990 RT	8	200

Push **Lift Spring Guide Assembly to Disengage** Unhook Fig. 2 **Retainer Pin Set Screw** Fig. 1 Remove 0 0 Fig. 3 Mounting **Disc Assembly Bracket**

Disc Assembly Removal Instructions 1. Remove the access cover.

- 2. Unfasten the two bolts on the bottom of the body opposite the access cover
- 3. Remove the spring guide assembly.
- 4. Reach in through the access opening and remove the entire clapper assembly, opening the clapper assembly and laying it flat on a table. (Refer
- 5. With an allen wrench, remove the setscrew which secures the spacer to the retainer pin on the clapper assembly.
- 6. Slide out the retainer pin to separate the disc assembly from the mounting bracket. Important: Each check repair kit fits (1) one check module.

Ordering Cod	de Kit No.	Si	ze
1st Check Rep	air Kits	in.	mm /
0887340	RK 990RPDA CK1	4	100
0887341	RK 990RPDA CK1	6	150
0887342	RK 990RPDA CK1	8	200
2nd Check Rep	pair Kits		mn
0887343	RK 990RPDA CK2	4	100
0887344	RK 990RPDA CK2	6	150
0887345	RK 990RPDA CK2	8	200
Kits consist of: Spring as	sembly & Cover O-ring		
Check Rubber	Parts	20.00	GERICA /
0887346	RK 990RPDA RC4	4	100
0887347	RK 990RPDA RC4	6	150
0887348	RK 990RPDA RC4	8	200
Kits consist of: Cover 0-r	ing, Bolt O-ring & Disc for one ch	neck	
Seat Kits	manin		
0887352	RK 990RPDA S	4	100
0887353	RK 990RPDA S	6	150
0887354	RK 990RPDA S	6 8	200
Kits consist of: Seat & Se	at 0-ring for one check		
Complete Rub	ber Parts		
0887361	RK 990RPDA RT	4	100
0887362	RK 990RPDA RT	6	150
0887363	RK 990RPDA RT	8	200

valve cover 0-ring, Piston 0-rings, Relief valve seat disc & Seat 0-ring

Comp	lete Re	pair Kit
OUITE	ICIC III	Pull IXIL

100

150

200

6

0887349	RK 990RPDA T	4	100
0887350	RK 990RPDA T	6	150
0887351	RK 990RPDA T	8	200

Kits consist of: 2 Cover O-rings, 4 Bolt O-rings, 2 Discs, 2 Spring assemblies, Relief valve, Stem assembly, Seat O-ring & Cover O-ring

RK 990 T

RK 990 T


RK 990 T


Servicing the Relief Valve

4" - 8" (100mm - 200mm)

To Service the Relief Valve:

- 1. Remove sensing hose. Check for debris.
- 2. Remove cover (A).
- 3. Remove diaphragm and stem assembly (B). Check seat disc (C) for debris and diaphragm (D) for cuts or tears. Repair or replace as necessary.
- 4. Lubricate only sealing O-rings with Dow Corning FS 1292. Do Not lubricate seat disc or diaphragm.
- 5. Reassemble and test.

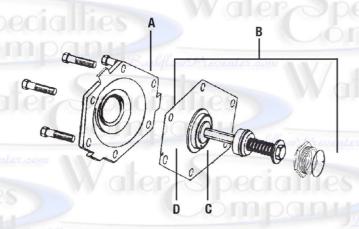

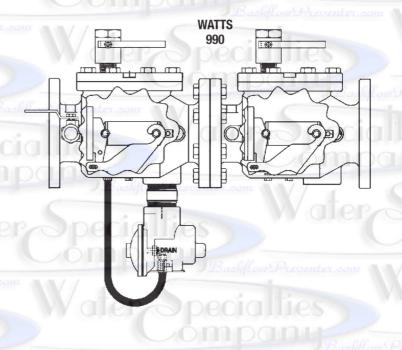

Relief Valve Repair Kits Series 990

Kit No.	Si	ze
BaskflowSte	in.	mm
RK 990 VT	4	100
RK 990 VT	6	150
RK 990 VT	8	200
em assembly. Seat 0-rid	ng & Cover O-ring	g.
er Parts	2 Backfle	WITH LEVE
RK 990 RV	4	100
RK 990 RV	6	150
RK 990 RV	8	200
	RK 990 VT RK 990 VT RK 990 VT em assembly. Seat 0-ri er Parts RK 990 RV RK 990 RV	in. RK 990 VT 4 RK 990 VT 6 RK 990 VT 8 em assembly. Seat 0-ring & Cover 0-ring Parts RK 990 RV 4 RK 990 RV 6

Series 990RPDA

Ordering Code	Kit No.		ze
Relief Valve Total	D Development	in.	mm
0887358	RK 990RPDA VT	4	100
0887359	RK 990RPDA VT	6	150
0887360	RK 990RPDA VT	8	200

Relief valve Rub	ber Parts	11	
0887361	RK 990RPDA RV	1410	100
0887362	RK 990RPDA RV	6	150
0887363	RK 990RPDA RV	8	200


Kits consist of: Relief valve diaphragm, Piston O-rings, Seat disc, Seat O-ring & Cover

Installation - Indoors

For indoor installations, it is important that the device be easily accessible to facilitate testing and servicing. If it is located in a line close to wall, be sure the test cocks are easily accessible. A drain line and air gap should be piped from the relief valve connection as shown, where evidence of discharge will be clearly visible and so that water damage will not occur. Therefore, never install in concealed locations.

*For Air Gap information contact your technical sales representative on back page.

*Note: For non-strainer models, test cock must be located on the first or inlet shutoff valve.

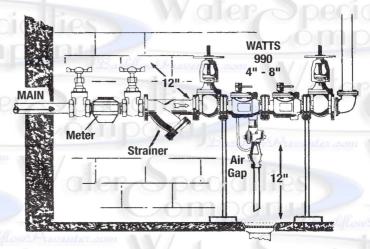


Installation - Outside Building Above Ground

In an area where freezing conditions occur, Series 990 can be installed inside a protective insulated or heated enclosure. The most satisfactory installation is above ground and should be installed in this manner whenever possible.

Series 990 should be installed in an accessible location to facilitate testing and servicing. A discharge line should be piped from the air gap at the relief valve connection making sure that there is adequate drainage. Never pipe the discharge line directly into a drainage ditch, sewer or sump. Series 990 should never be installed where any part of the unit could become submerged in standing water. Consideration should be given to the installation of external support structure as applicable.

It is generally recommended that backflow preventers never be placed in pits unless absolutely necessary and then only when approved by local codes. In such cases, a modified pit installation is preferred.

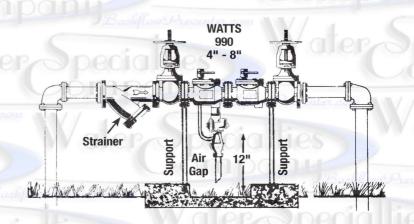

Installation - Parallel Devices CONSULT LOCAL CODES FOR APPROVAL

Two or more smaller size valves can be piped in parallel (when approved) to serve a larger supply pipe main. This type of installation is employed where increased capacity is needed beyond that provided by a single valve and permits testing or servicing of an individual valve without shutting down the complete line.

The number of assemblies used in parallel should be determined by the engineers judgement based on the operating conditions of a specific installation.

