

For Health Hazard Applications

1-800-336-6530

Water Specialties Company
Backflow Preventer.com

WATTS®
REGULATOR

Series 994RPDA Reduced Pressure Detector Assemblies

Sizes 2½" – 6" (65 – 150mm)



Series 994RPDA Reduced Pressure Detector Assemblies are designed for use in accordance with water authority-containment programs. This series is normally used in health hazard applications to protect against backsiphonage and backpressure. This series can be used to prevent the reverse flow of fire protection substances, i.e., glycerin wetting agents, foam agents, stagnant water, auxiliary supplies and water of non-potable quality from being pumped or siphoned into the potable water supply.

Features

- Stainless steel construction provides long term corrosion resistance and maximum strength
- Stainless steel body is half the weight of competitive designs reducing installation and shipping costs
- Short end to end dimensions makes retrofit easy
- Bottom mounted relief valve reduces clearance requirements when installed against an outside wall
- Torsion spring check valves provides maximum flow at low pressure drop
- Thermoplastic & stainless steel check valves for trouble-free operation
- No special tools required for servicing
- Compact construction allows for smaller enclosures
- Stainless steel relief valve features a balanced rolling diaphragm to eliminate sliding seals and lower maintenance costs
- Detects underground leaks and unauthorized water use.
- GPM or CFM meter available

Specifications

A Reduced Pressure Detector Assembly shall be installed at each cross-connection to prevent backsiphonage and backpressure of hazardous materials into the potable water supply. The assembly shall consist of a pressure differential relief valve located in a zone between two positive seating check valves. The main valve body shall be manufactured from 300 Series stainless steel for corrosion resistance. The check valves shall be of thermoplastic construction with stainless steel hinge pins, cam arm, and cam bearing. The check valve shall utilize a single torsion spring design to minimize pressure drop through the assembly. The check valves shall be modular and shall seal to the main valve body by the use of an O-ring. There shall be no brass or bronze parts used within the check assembly or relief valve. The use of seat screws to retain the check valve seat is prohibited. All internal parts shall be accessible through a single cover on the valve assembly securely held in place by a two-bolt grooved coupling. The differential relief valve shall be of stainless steel construction and shall utilize a rolling diaphragm and no sliding seals. The relief valve shall be bottom mounted and supplied with a steel reinforced sensing hose. The assembly shall include two resilient shutoff valves and four ball type test cocks and a hydraulically balanced bypass line. The bypass line shall include a meter, small diameter reduced pressure zone assembly and isolation valves. The bypass reduced pressure assembly shall have a single bolted on cover and top mounted test cocks. The assembly shall be a Watts Series 994RPDA.

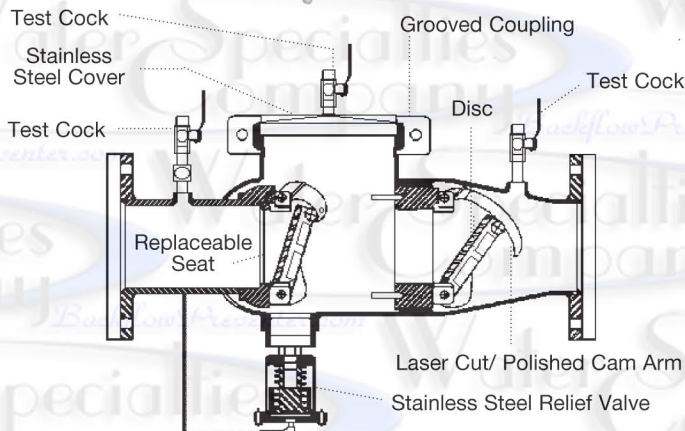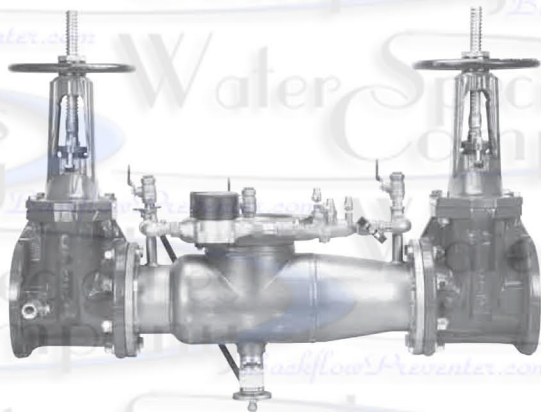

Models

Suffix:

- LF – without shutoff valves
 OSY – UL/FM outside stem and yoke resilient seated gate valves
 *OSY FxG – flanged inlet gate connection and grooved outlet gate connection
 *OSY GxG – grooved inlet gate connection and flanged outlet gate connection
 *OSY GxG – grooved inlet gate connection and grooved outlet gate connection
 CFM – cubic feet per minute meter
 GPM – gallons per minute meter

Available with grooved NRS gate valves - consult factory*

Post indicator plate and operating nut available - consult factory*

*Consult factory for dimensions

Note: The installation of a drain line is recommended. When installing a drain line, an air gap is necessary.

Now Available
WattsBox Insulated Enclosures.
 For more information, send for literature ES-WB.

**IMPORTANT: INQUIRE WITH GOVERNING AUTHORITIES
 FOR LOCAL INSTALLATION REQUIREMENTS**

WATTS®

Watts products specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

Materials

All internal metal parts: 300 Series stainless steel

Main valve body: 300 Series stainless steel

Check assembly: Noryl®

Flange dimension in accordance with AWWA Class D




Pressure — Temperature

Temperature Range: 33°F – 110°F (0.5°C – 43°C) continuous


Maximum Working Pressure: 175psi (12.1 bar)

Capacity

*Typical maximum flow rate (7.5 feet/sec.) **UL rated flow

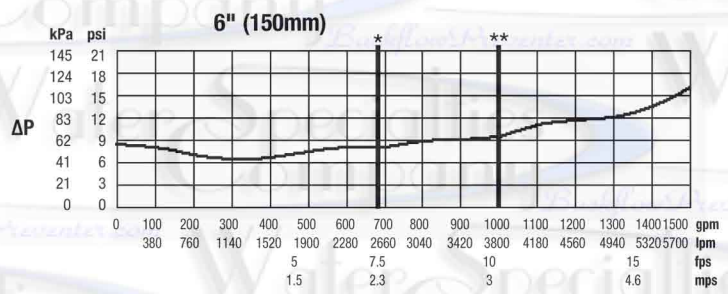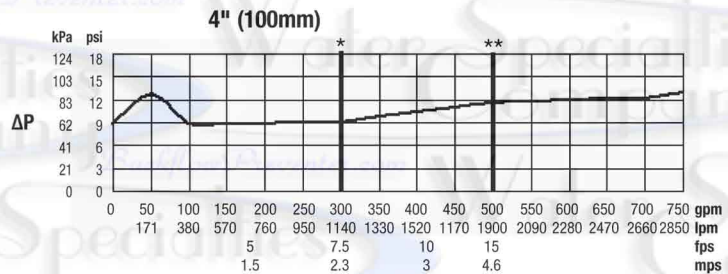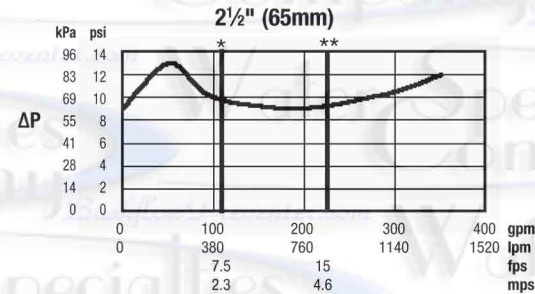

Dimensions — Weights

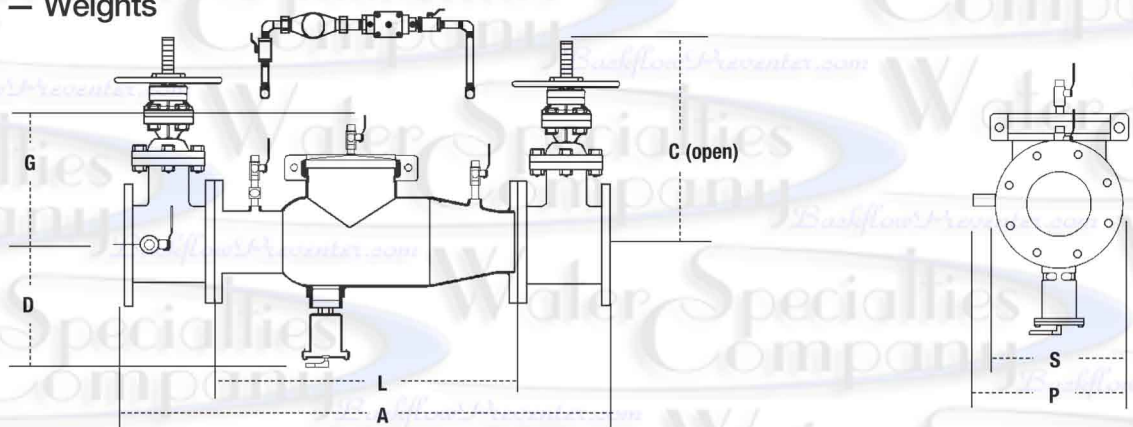

SIZE (DN)		DIMENSIONS				WEIGHTS											
in.	mm	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P
2½	65	37	940	16⅜	416	10½	267	10	254	22	559	12½	318	7	178	170	77
3	80	38	965	18⅞	479	10½	267	10	254	22	559	13	330	7½	191	205	93
4	100	40	1016	22¼	578	10½	267	10	254	22	559	14½	368	9	229	270	122
6	150	48½	1232	30⅞	765	11½	292	11½	292	27½	699	15½	394	11	279	405	184

Noryl® is a registered trademark of General Electric Company

WATTS®

A Watts Water Technologies Company

USA: No. Andover, MA • Tel: (978) 688-1811 • Fax: (978) 794-1848 • www.watts.com

Canada: Burlington, ON • Tel: (905) 332-4090 • Fax: (905) 332-7068 • www.wattscanada.ca